


Uniclass L5:P2:N32	EPIC E:X2:Y421
CI/SfB	Rf9 (K2)+(K3)

December 2003

**Promat**



# The Passive Fire Protection Handbook

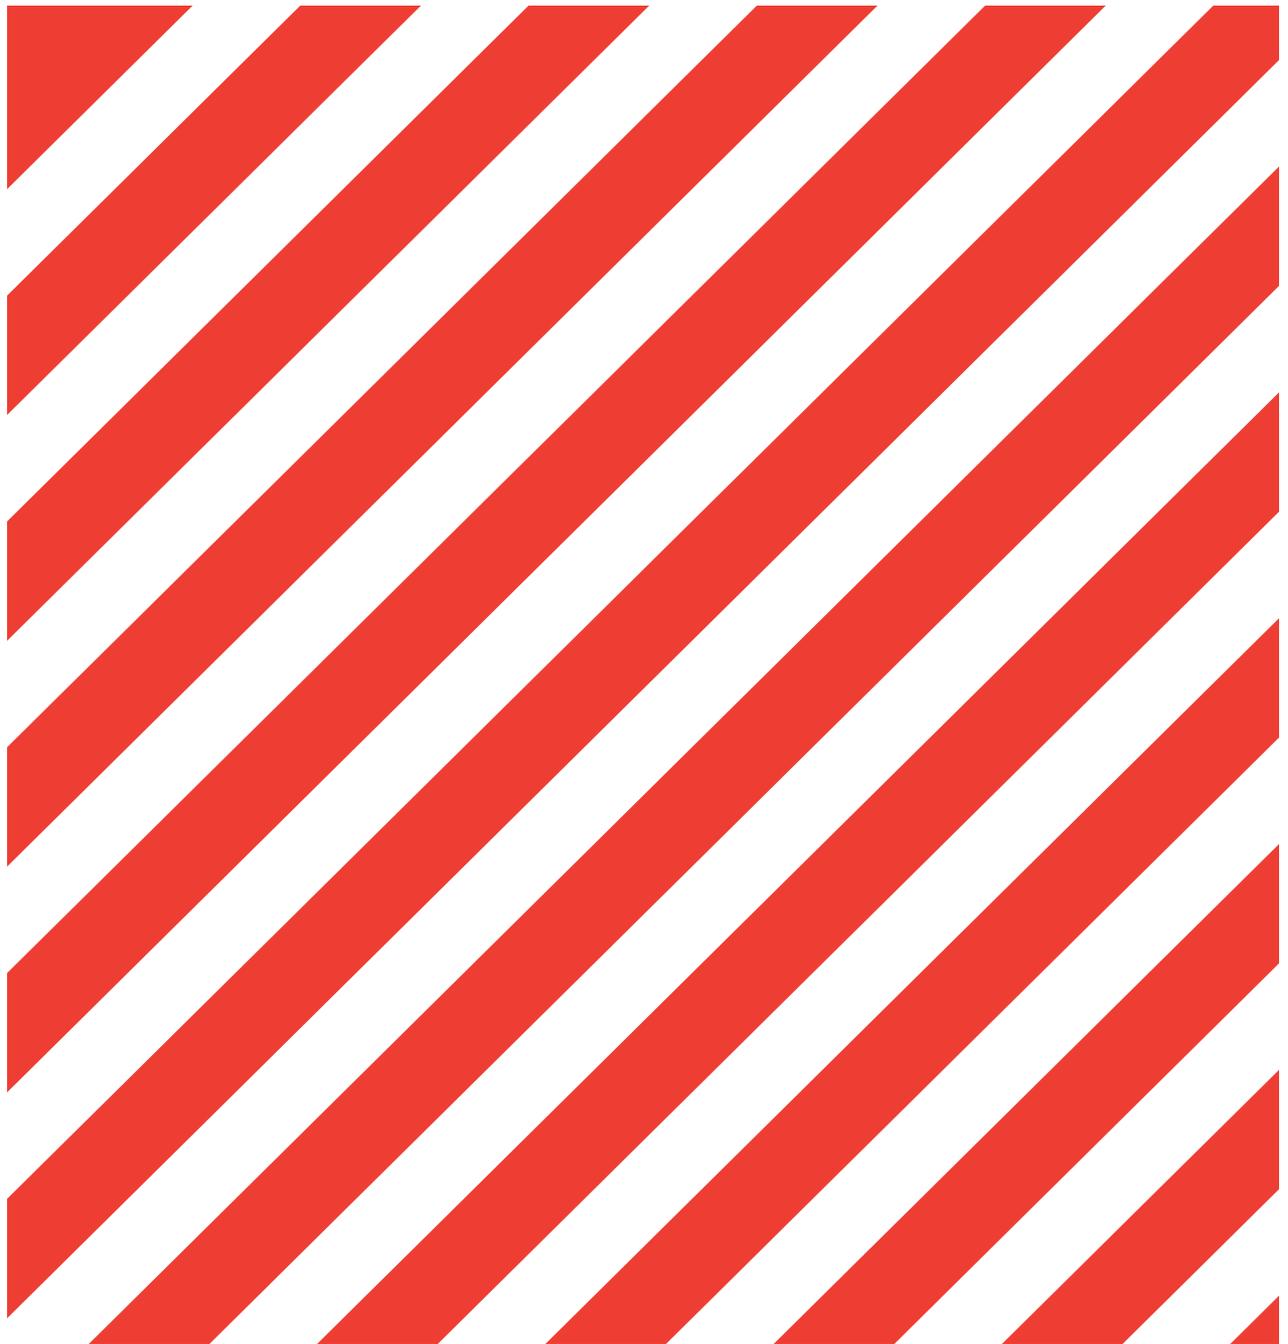

### VICUCLAD®

#### Applications

- Fire protection of metal ducts
- Construction of smoke extract ducts
- Mechanical & electrical service enclosures

#### Typical Mechanical Properties

Flexural strength $F_{rupture}$	Average, dry	N/mm <sup>2</sup>	0.8
Modulus of elasticity $E$	Average, dry	N/mm <sup>2</sup>	940
Compressive strength (average, dry perpendicular to board face)		N/mm <sup>2</sup>	0.95

#### General Description

A non-combustible board in which the unique cellular structure of vermiculite is maintained and controlled by a pre-treatment process. This gives excellent thermal insulation properties with dimensional stability at high temperatures. It is used to provide up to 240 minutes fire protection to protect sheet metal ducts and for the construction of smoke extract ducts.

This versatile material is also produced in semi-circular sections known as VICUTUBE®, which is used to protect circular steel sections and plastic pipes.

#### VICUBOND® WR

A ready-to-use, one part non-combustible cement for fixing VICUCLAD® boards to structural steelwork and to adjacent boards. It may also be used for gap filling. Delivered as semi liquid in 10 litre drums. Allow 1 litre for each 1.5m<sup>2</sup> of 25mm VICUCLAD® board. Other thicknesses require a pro-rata amount.

A health and safety data sheet is available from the Promat Technical Services Department and, as with any other materials, should be read before working with the board.

The board is not classified as a dangerous substance and so no special provisions are required regarding the carriage and disposal of the product to landfill. They can be placed in an on-site skip with other general building waste which should be disposed of by a registered contractor.

**Table 1. General Technical Data**

Designation	Vermiculite
Material class	Non-combustible
Surface spread of flame	Class 1
Building regulations classification	Class 0
Nominal dry density (average) Kg/m <sup>3</sup>	405
Alkalinity (approximately) pH	8-9
Thermal conductivity (20°C) W/mK	0.09
Coefficient of expansion (20-600°C) m/mK	16 x 10 <sup>-6</sup>
Nominal moisture content (air-dried) %	2-7
Standard thickness VICUCLAD® 900R mm	18-35
VICUCLAD® 1050R mm	45-75
Thickness tolerance (mm)	±1.5
Tolerance for length/width (mm) up to 40 mm	+6.0 to -0
45-80 mm	+10 to -0
Surface condition	Smooth, oatmeal texture and colour

**Table 2. VICUCLAD® Board Format Data**

Thickness* (mm)	Length x Width (mm)	Approx.Weight (kg/m <sup>2</sup> )	
		Dry	With approx. 6% moisture
18	1000 X 610	7.3	7.7
25	1000 X 610	10.1	10.7
35	1000 X 610	14.2	15.0
45	1000 X 610	18.2	19.3
55	1000 X 610	22.3	23.6
65	1000 X 610	26.3	27.9
75	1000 X 610	30.4	32.2

\* Other thicknesses are available on request.

**Table 3. VICUTUBE® Format Data**

Internal diameter	Tolerance (mm)	Wall thickness (mm)			Tolerance (mm)
		30	40	50	
48	+2 to +5			●	+2 to -1
60	+2 to +5	●	●	●	+2 to -1
76	+2 to +5	●	●	●	+2 to -1
89	+2 to +5	●	●	●	+2 to -1
114	+2 to +5	●	●	●	+2 to -1
140	+2 to +5	●	●		+2 to -1
168	+2 to +5	●	●		+2 to -1
194	+2 to +5		●		+2 to -1
219	+2 to +6	●	●		+2 to -1
245	+2 to +6		●		+2 to -1
273	+2 to +6		●		+2 to -1

Standard format: Semi circular x 667mm long

**NOTE:** All physical property values are averages based on standard production. The figures can change dependent on the test methods used. If a particular value is of prime importance for a specification requirement, please contact Promat Technical Services Department.

### CUTTING

Promat boards can be worked with conventional woodworking equipment although the use of hand saws with hardened teeth is recommended.

Promat boards greater than 6mm in thickness may be more easily cut using a power circular saw in conjunction with tungsten carbide tipped blades, or a jigsaw. For rough cutting, 6mm sheets can be deeply scribed and broken over a straight edge.

DURASTEEL® can be cut with a jigsaw around services etc. For the cutting of straight edges, a guillotine is recommended for large areas.


Promat recommend that all cutting should be carried out in well ventilated spaces, using dust extractors. Operators should wear protective face masks.



Cutting with a Jigsaw.



Cutting with a circular saw.

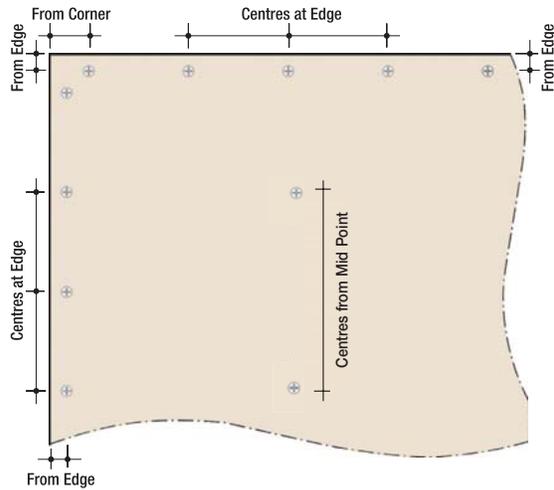

### FASTENING & FIXING

#### 1. Nailing

The most economical method of fastening is to use pneumatic nailing and stapling equipment.

Nails can be driven directly through boards, without pre-drilling (excluding DURASTEEL®), provided they are at least 12mm from the edge of the board, and the back face of the board is fully supported.

In areas of high humidity, galvanised nails should be used.

Panel pins, oval or lost head nails should not be used.

Nails should be located 40mm from corners.

Fixing guide as below, used with drawing above:

From Edge	From Corner	Centres at Edge	Centres from Mid Point
Min. 12mm	Min. 40mm	Min. 150mm	Max. 300mm

#### VICUCLAD® Vermiculite Board

Nails should be used in conjunction with VICUBOND® WR.

When edge fixing to another board or VICUCLAD® nogging, the length of the nails should be twice the board thickness.

When fixing to the face of another board or batten, nails should be half the board thickness from edge of the board.

### 2. Screw Fixing

Pilot holes should be pre-drilled not less than 12mm from the edge of the boards and countersunk if required. Use self-drilling or self-tapping screws when securing boards to steel. For all other situations, drywall screws e.g. Hilo are generally suitable.

Boards of thicknesses greater than 15mm can be edge screwed. Self-drilling or self-tapping screws are suitable. If edge screwing the board, minimum screw penetration should be 30mm. If screws do not have a deep thread, pilot holes should be drilled and care should be taken not to overtighten. Screws should be minimum 40mm from corners.

Screws at corners should be positioned at a distance equal to the board thickness from the corner, or a minimum of 40mm, whichever is the greater. Boards can be edge screwed or screwed face to face. Care should be taken not to overtighten screws. For best results using screws, variable speed electric screw drivers with a torque control have proven the most successful.

### 3. Adhesive Fixing

Multi-purpose glue or bonding compound can be used for non fire rated applications. VICUCLAD® boards may be fixed using a specially developed, non-combustible adhesive, VICUBOND® WR, in conjunction with nails.



### BUTT JOINTING


Boards can be simply butt jointed with sheets having square, bevelled or chamfered edges. If required, a filler may be used to finish joints before decoration. Adhesives are not required.

### VICUCLAD® Vermiculite Board

Joints between boards and noggings should be filled with VICUBOND® WR. This can also be used to fire stop the junction to adjacent components. Adhesive is not required when using the mechanical fix method. The adhesive has no flexibility when set and should therefore not be used where movement is expected.

### INSTALLATION OPTIONS

- a) Promat boards can be fastened with self-tapping screws and drivers with torque control.
- b) Promat boards are easily fixed with pneumatically operated stapling equipment.
- c) Boards can be trimmed and shaped using hand-held handsaws.
- d) For on-site cutting use carbide tipped blades fitted to circular saws.

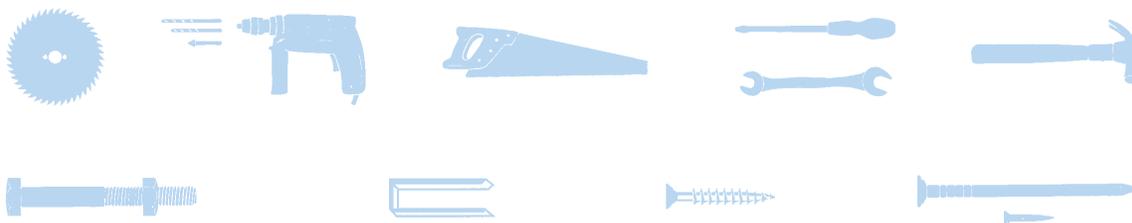

## FINISHING OF BOARD SYSTEMS

Promat materials provide a surface ready to receive most forms of decoration. Where finishes such as wallpaper are to be used, application can be made easier by first sealing the board with a proprietary sealer or paint.

## PLASTERING



All calcium silicate boards have a high suction and therefore it is generally difficult to apply gypsum plaster. If plastering is essential please consult the Promat Technical Services Department.

It is recommended that a small test area is plastered initially to ensure that the boards have been adequately sealed. It is advisable that self-adhesive or hessian scrim is applied over joints and internal angles. Paper scrim is not recommended.

**NOTE:** The bonding agent and plaster manufacturers' recommendations should be followed at all times.

### VICUCLAD® Vermiculite Board

Adhesion of plaster to VICUCLAD® is excellent. Either one 5mm coat of board finish or a two-coat application of bonding coat and then finish coat. Although not required for bonding purposes, PVA coatings can be used on the board to retard the setting time of plasters.

The plaster manufacturers' recommendations should be followed at all times.

## TILING



### SUPALUX® & MASTERBOARD®

Boards at least 9mm thick should be used and sealed on all faces with either diluted tile adhesive or a PVA sealant. Screw boards at maximum 200mm centres to supports at maximum 405mm centres in both directions before applying tiles with standard tile adhesive.

### VICUCLAD® Vermiculite Board

Tiles can be applied directly to VICUCLAD® using VICUBOND® WR adhesive.

**NOTE:** For tiling all other Promat products, please contact Promat Technical Services Department.

## PAINTING



All coatings should be supplied by a reputable manufacturer and their recommendations regarding surface preparation, sealing and finish coat should be followed.

Promat boards have an attractive, smooth finish but if required they can be painted with emulsion or oil based paints. With water based paints, a diluted first coat should be used. For oil based paints a suitable alkali resisting primer should be used. Painted vapour barriers may be formed by the application of chlorinated rubber, epoxy resin or polyurethane paint.

### VICUCLAD® Vermiculite Board

If a decorative finish is required, the surface of the VICUCLAD® should be sealed with an oil based alkali resistant primer prior to the application of oil based paints. It is recommended that emulsion or textured paints are used undiluted.

**PROMAT TECHNICAL SERVICES DEPARTMENT**

Telephone: 01344 381400

Fax: 01344 381401

Email: [technicaluk@promat.co.uk](mailto:technicaluk@promat.co.uk)**PROMAT MARKETING SERVICES DEPARTMENT**

Telephone: 01344 381350

Fax: 01344 381401

Email: [marketinguk@promat.co.uk](mailto:marketinguk@promat.co.uk)**PROMAT CUSTOMER SERVICES DEPARTMENT**

Telephone: 01344 381381

Fax: 01344 381380

Email: [salesuk@promat.co.uk](mailto:salesuk@promat.co.uk)**PLEASE NOTE:**

Every care has been taken to ensure that the contents of this Handbook are accurate, however, Promat UK Limited and its subsidiary companies cannot accept any responsibility for omissions, errors or for information which is found to be misleading. Some of the specifications used in this Handbook may not be complete and may not give full fixing details and it is your responsibility to satisfy yourself of the suitability of any specifications mentioned to meet your requirements. If further assistance is required please contact Promat Technical Services Department. In all cases all current building regulations and approved documents and local fire authorities and insurers must be consulted as appropriate.

The information and recommendations contained in this Handbook are based upon the best knowledge available at the time of publication. Promat UK Limited reserve the right to alter products and specifications without notice.

Produced and typeset at Promat UK Limited.